06222021

D.A.I. SCIENTIFIC EQUIPMENT

CUTSHEET

Exterior
DAI-HC-MFP-17

Front View

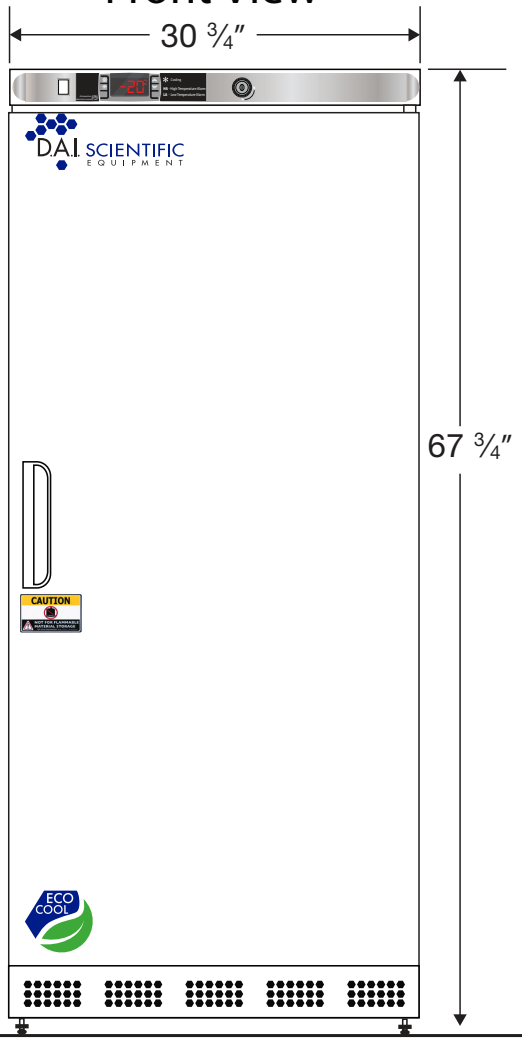

Side View

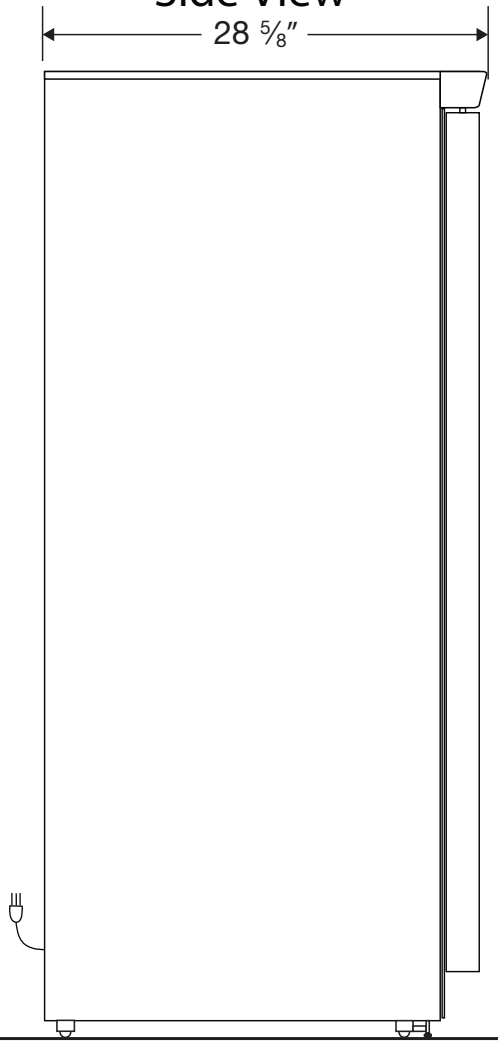

Top View

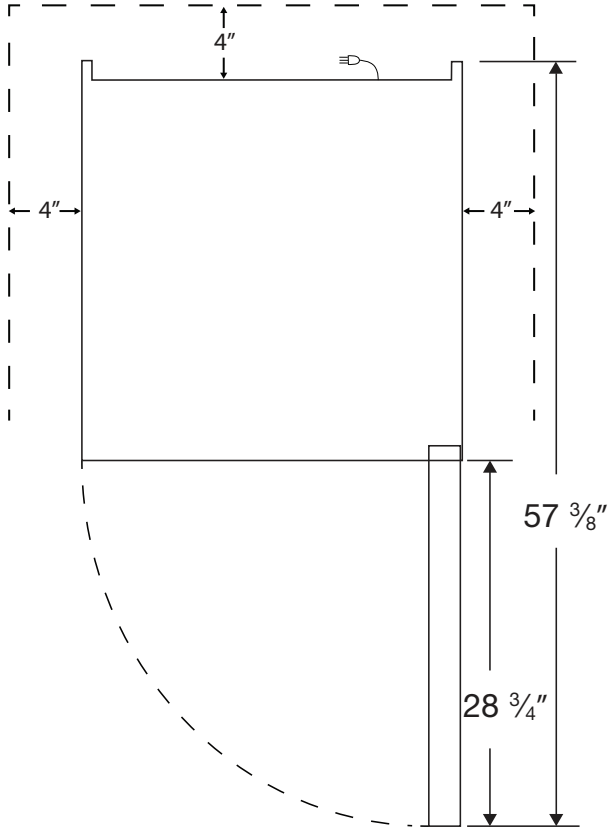

115VAC/60Hz/1PH
NEMA-5-15P

NOTE: Ventilation Requirements – Minimum 4” clearance on sides and back

Cu. Ft	Defrost	Door	Int Door	Shelves	W″	D″	H″	Refrigerant	H.P.	Amps	Weight
17	Manual	1 Solid	0	6 Fixed	30 ¾	28 ⅝	67 ¾	R290	½	6	190 lbs.